


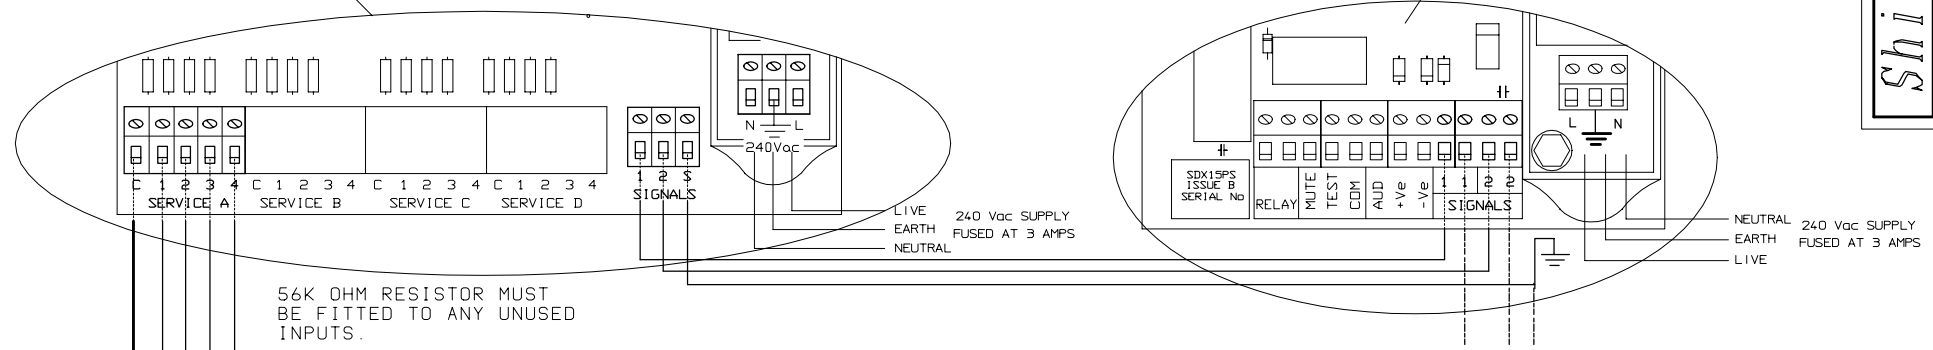


CENTRAL OR REPEATER  
ALARM PANELS

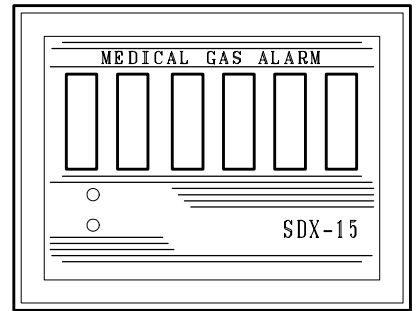

TERMINATION BOARD  
MUST BE MOUNTED AS  
CLOSE AS POSSIBLE  
TO THE PLANT OR  
MANIFOLD CONTACTS



PRESSURE FAULT  
RESERVE  
LOW  
CHANGE CYLINDERS  
IMMEDIATELY  
CHANGE  
CYLINDERS

TO OTHER SDX-15  
EQUIPMENT AS  
REQUIRED

NOTE

ALL SIGNAL CABLE TO BE A MINIMUM  
OF 0.5 mm sq SCREENED / S.W.A /  
OR IN METAL CONDUIT.

ALL JUNCTION BOXES MUST HAVE  
THE SCREENS CONNECTED THROUGH

ALL SCREENS MUST BE EARTHED

*Shire Controls Ltd*

Title

CONNECTIONS TO A 1 GAS  
SDX-15 REMOTE TRANSMITTER

Drawing No SDXRTX1

Date 17-10-2000 Issue 1