
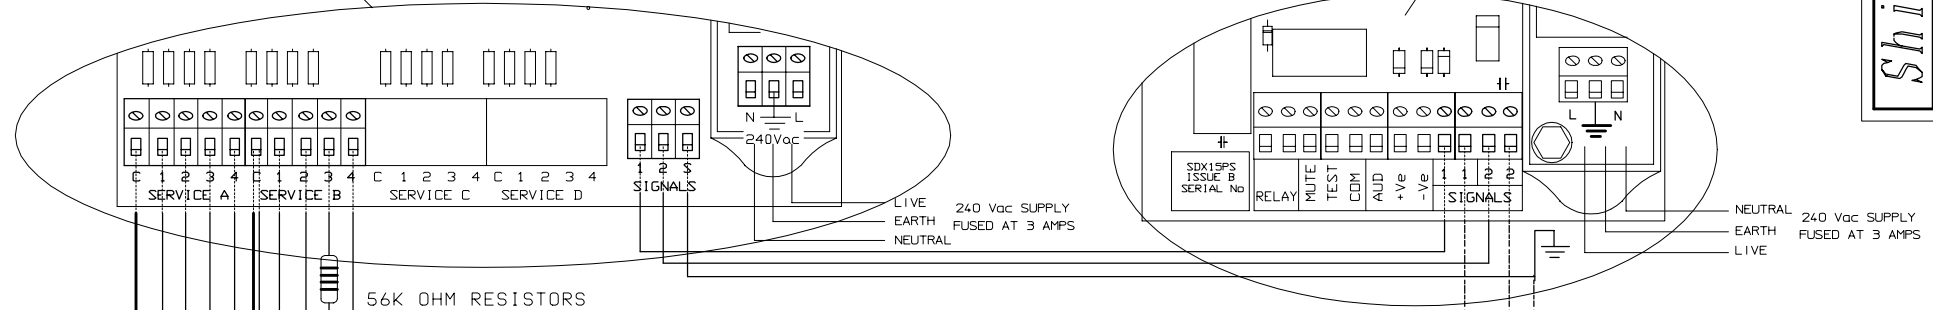
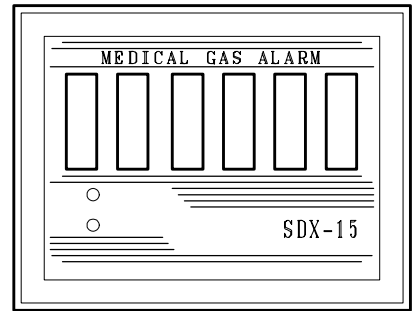


CENTRAL OR REPEATER ALARM PANELS

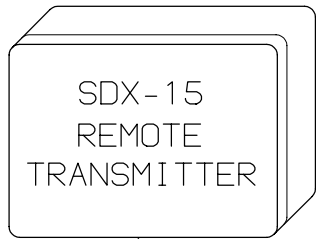

56K OHM RESISTORS
MUST BE FITTED TO
ANY UNUSED INPUTS



NOTE

ALL SIGNAL CABLE TO BE A MINIMUM
OF 0.5 mm sq SCREENED / S.W.A /
OR IN METAL CONDUIT.



ALL JUNCTION BOXES MUST HAVE
THE SCREENS CONNECTED THROUGH.

SCREENS MUST BE EARTHED

NOTE
TERMINATION BOARDS
AND BOXES MUST BE
MOUNTED AS CLOSE
AS POSSIBLE TO THE
PLANT OR MANIFOLD
CONTACTS

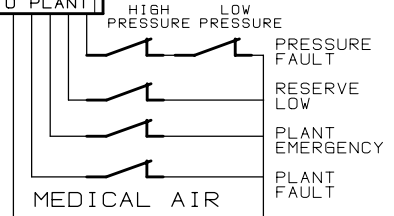

CONTACTS & PRESSURE SWITCHES

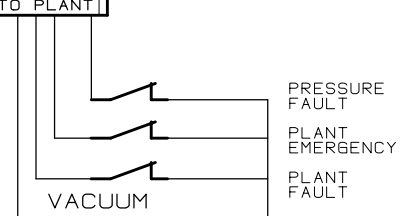

CONTACTS & PRESSURE SWITCHES

TO OTHER SDX-15
ALARM AND EQUIPMENT
AS REQUIRED

